


1 Scope of application and use


1.1 Application

NDG3VH -160/250/315 (G) & NDG3VH -100/200/250/275 (U) isolating switch is suitable for low-voltage distribution network with DC1500V and below, rated working current of 315A and below, as infrequent making, breaking circuit and Line isolation. It can provide open circuit and overload protection functions.


1.2 Product pictures

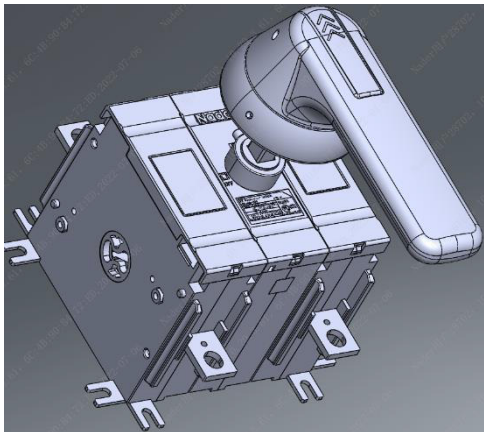

NDG3VH -250/2/11ZP

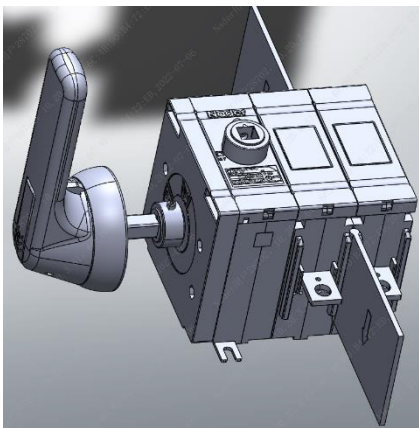

NDG3VH-250/2/02CP

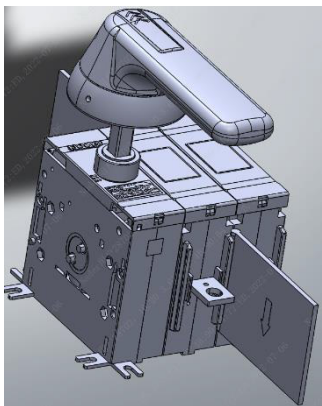

NDG3VH-250/2/02ZP

2 Product models

2.1 Certified Models

NDG3VH-100/200/250/275 (U) UL

NDG3VH-160/250/315 (G) CCC/CE/TUV

2.2 Model Explanation

NDG 3V H- □ / □ / □ □ □ / □ / □ □
1 2 3 4 5 6 7 8 9 10 11 12

No.	Code name	Code description
1	Enterprise code	ND Manufacturer code
2	Product Code	G Disconnecter
3	Design code	3V
4	Design code	H High parameter
5	Rated current (A)	In: UL : 100/200/250/275 CCC/CE/TUV : 80/100/125/160/200/225/250/275/315
6	Number of poles	2: 2 poles 4: 4 poles
7	Mechanism splicing	02: 2 poles/mechanism left; 11: 2 poles/body centering 22: 4 poles/body centering (two-circuit)



8	Operation mode	Z: Standard operation C: Side operation
9	Handle type	P: No handle (with handle outside the switchgear, it needs to be ordered separately, see "Handle + Shaft with Standard Accessories" for details) K: Directly operate the handle in the switchgear
10	Certified type	G: CCC/CE/TUV U: UL
11	Foot installation	01: Regular 1, 02: Regular 2, 03: Regular 3
12	Application code	Application code

3 Main technical parameters

3.1 Compliance with standards

UL98B

GB/T 14048.1 ; GB/T 14048.3 ;

IEC 60947 -1; IEC 60947 -3;

3.2 Technical parameters

Parameters	Description										
Numberof poles	2: 2 poles 4: 4 poles two-circuit										
Frame sizecurrent (A)	UL:100 /200/250/275 CCC/CE/TUV:160/250/ 315										
Rated current (A)	UL Certification										
	Frame size		100	200	250	275					
	Rated current		100	200	250	275					
	CCC/CE/TUV Certification:										
	Frame size		160				250			315	
	Rated current		80	100	125	160	200	225	250	275	315
Rated voltage	DC 1000V / DC 1500V										
Insulation voltage Ui	1500V										
Rated short-circuit making capacity Icm	10kA										
Pollution level	3										
Rated short-time withstand current Icw	CCC/CE/TUV:20kA/0.15s,8kA/1s UL： 10kA/50ms										
Limiting short -circuit current (Iq) (fuse) ^①	30kA										
Rated impulse withstand voltageUimp	12kV										
Protection class	IP66 outside the switchgear IP20 inside the switchgear										

Operation method	Standard operation, side operation (side operation is an extended operation method)
Electrical endurance	400times (200A and below 1000 times)
Mechanical endurance ^②	Standard operation : 10000 times Side operation : 2000times(extended operation method)
Usage category ^③	UL : UL98B CCC/CE/TUV: DC -21B/PV1
Operating torque	Standard operation : 7.5~12N.m, side operation 4~6N.m
Wiring capability(M8)	UL : NDG3VH -275 Wide:22mm , thickness:4mm copper bar:2 CCC/CE/TUV: NDG3VH -315 185mm ² copper wire 1 NDG3VH -250 120mm ² copper wire 1 NDG3VH -160 70mm ² copper wire 1 Auxiliary switch:0.75-2.5mm ²
Terminal tightening torque (Tightening torque)	main circuit :15N.m Auxiliary circuit :0.8 N.m
Certification	UL CCC/CE/TUV

Note: No. ① is under DC415; No. ② means maintenance mechanical endurance, otherwise according to GB or UL standards, No. ③, PV1 category does not include side-operated models.

4 Environment

4.1 Environmental Requirements

Environmental Requirements	Description
Ambient temperature	-40℃ ~ +85℃, when the ambient temperature is above + 70℃, derating is required. The derating factor is as follows
Altitude	Below 5000 meters, when the altitude is 2000m -5000m, derating is required. The derating factor is as follows
Pollution level	Pollution level 3; in a medium without explosion hazard, and the medium has no gas and conductive dust enough to corrode metals and destroy
Protection class	Insulation: in a place without rain and snow IP20 inside the switchgear, IP66 outside the switchgear (with optional CS1-A handle meets IP40)

1) Altitude: below 5000 meters


NDG3VH -160/250/315 (G) & NDG3VH -100/200/250/275(U) Altitude derating factor table						
Altitude	2000m	2500m	3000m	3500m	4000m	5000m
Power frequency withstand voltage	5000V	5000V	5000V	5000V	5000V	4000V
Working current correction factor	1	0.96	0.93	0.90	0.88	0.82
Working voltage correction factor	1	1	1	1	1	1

2) Ambient temperature: $40^{\circ}\text{C} \sim +85^{\circ}\text{C}$

NDG3VH -160/250/315 (G) & NDG3VH -100/200/250/275 (U) Ambient temperature derating coefficient table				
Ambient temperature	70℃	75℃	80℃	85℃
Power frequency withstand voltage	5000V	5000V	5000V	5000V
Working current correction factor	1	0.95	0.92	0.88
Working voltage correction factor	1	1	1	1

3) In a non-explosive medium, and the medium has no gas and conductive dust enough to corrode metals and destroy insulation; in a place without rain and snow.

5 Product appearance and installation dimensions

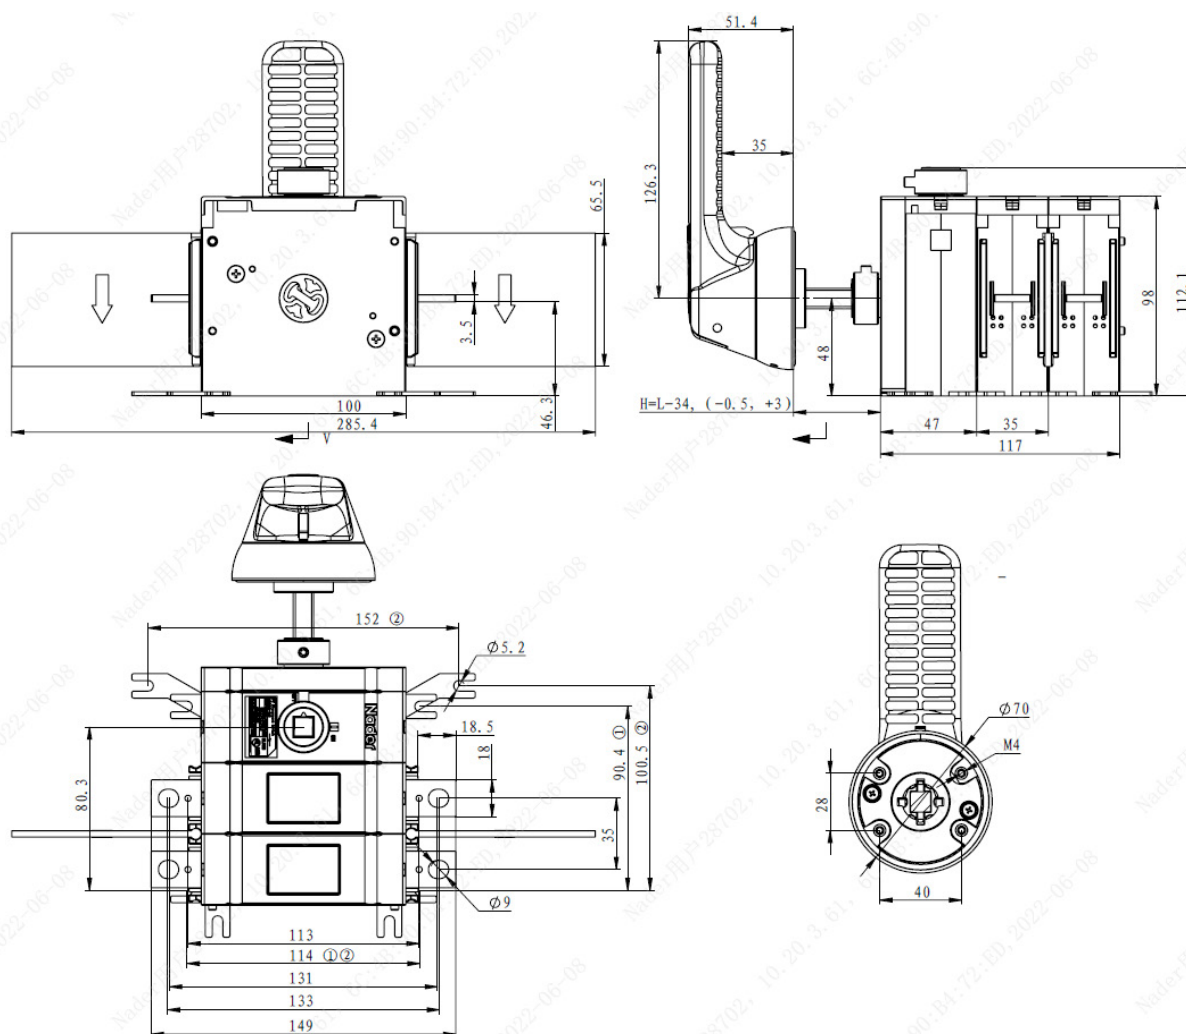

Side operation outline installation drawing

Disconnect Switch


NDG3VH-160 250 315 (G) & NDG3VH-100 200 250 275 series

QUISURE

Keep quick, Make sure

ISO9001:2015

QUALITY GUARANTEED

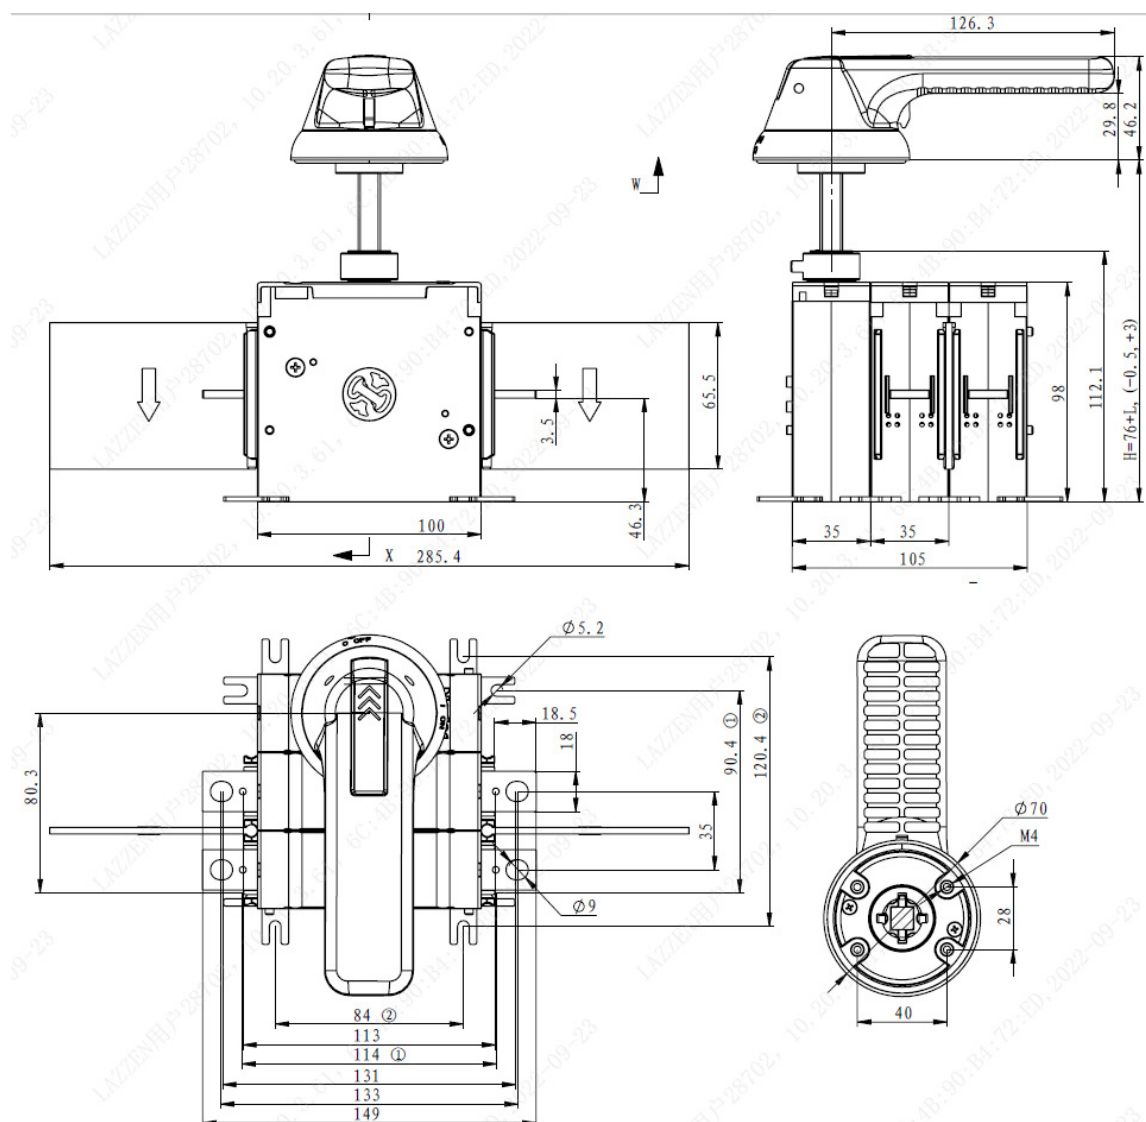

Standard operation outline installation drawing

CCC, CE, TUV, UL

Disconnect Switch


NDG3VH-160 250 315 (G) & NDG3VH-100 200 250 275 series

QUISURE


Keep quick, Make sure

ISO9001:2015

QUALITY GUARANTEED

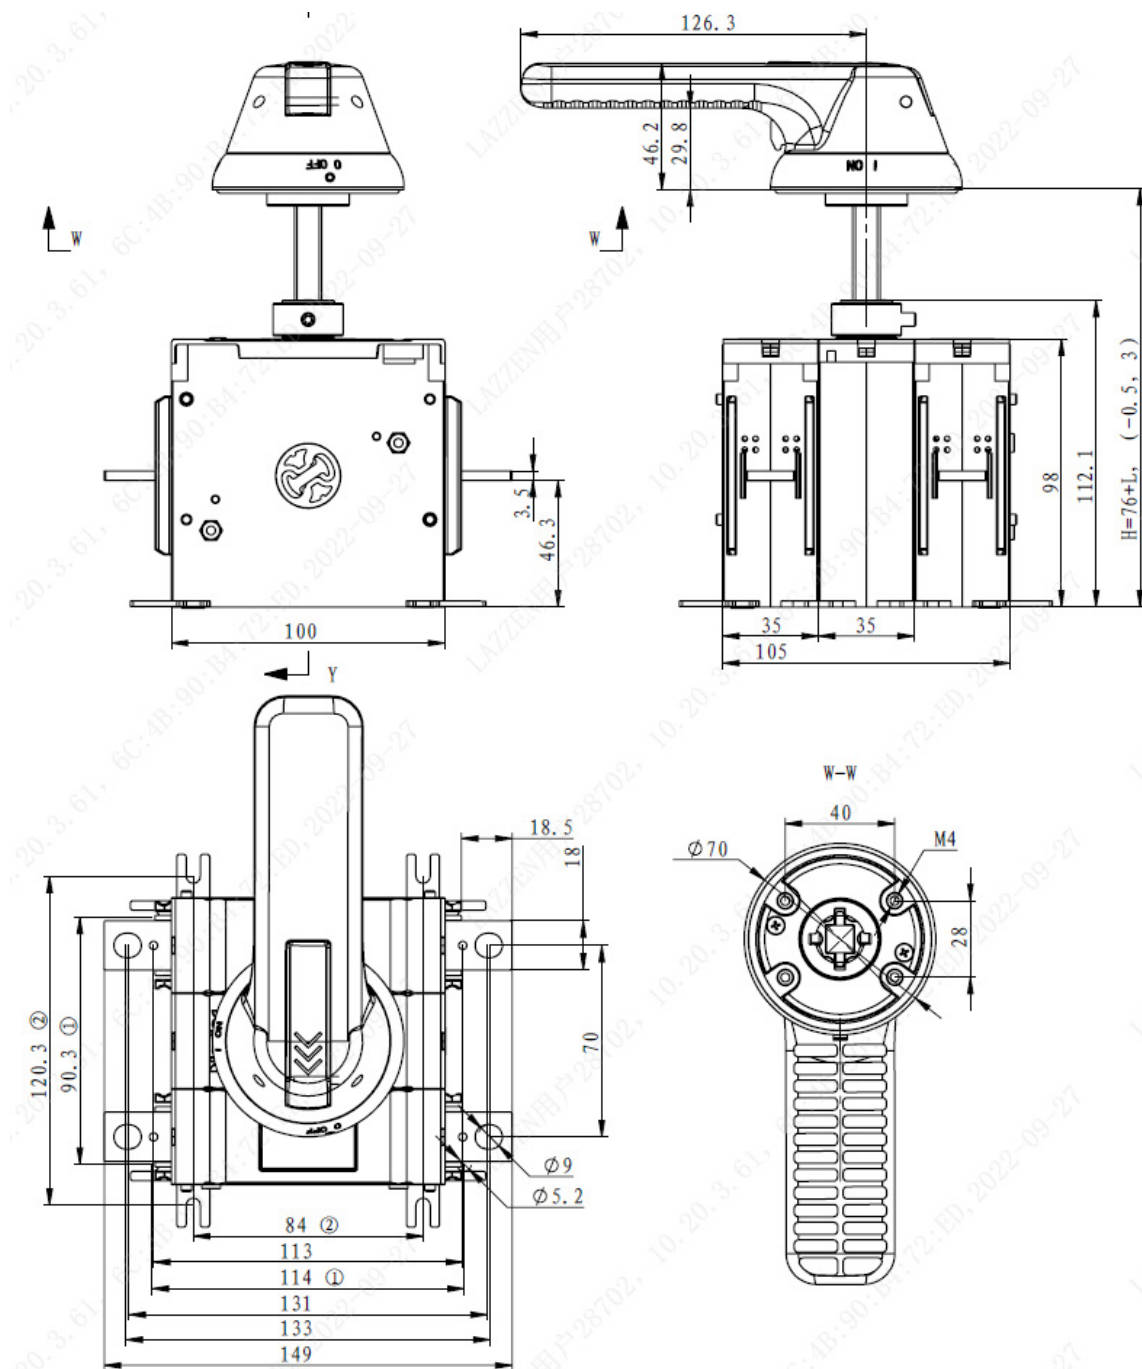

Standard Operation (Mechanism Centered) Outline Installation Drawing

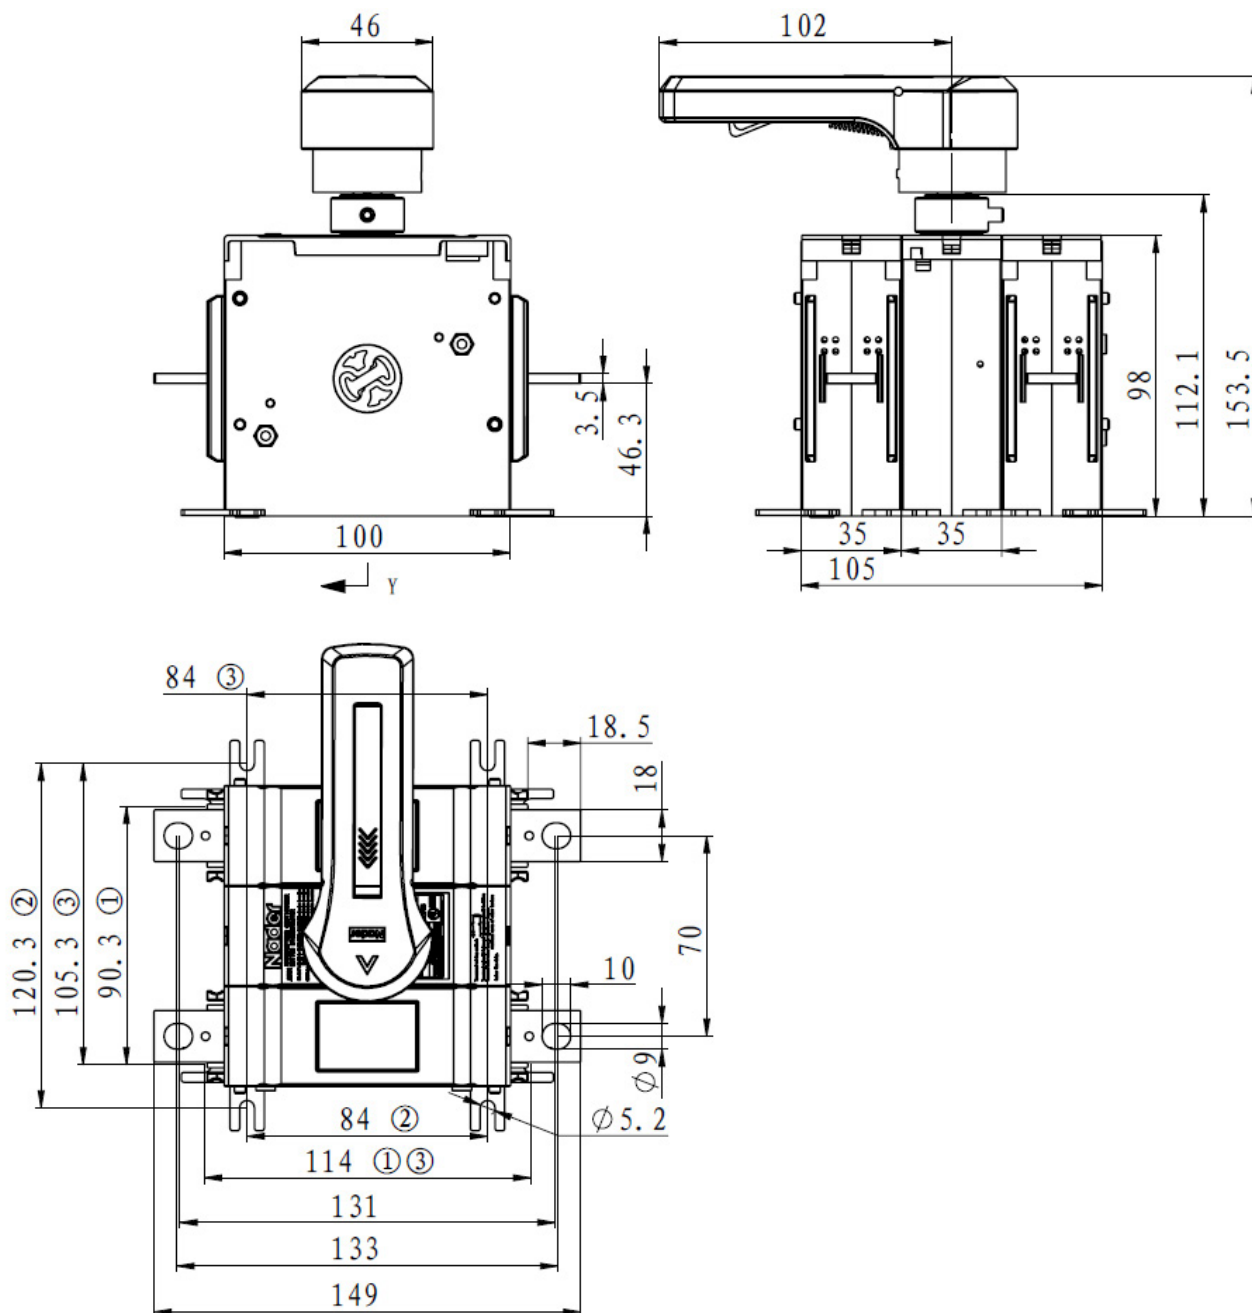

Forward operation (center of cabinet mechanism) Outline installation drawing (opening)

Note: The handles outside the switchgear are all SB type by default. For the optional length L of the square shaft, see the description of the handle model in 7.1.1;

For each shape, the serial numbers ① and ② on the foot installation dimension mark represent the normal 1 and normal 2 in the 10th bit of the 6.2 Model Explanation. If there is no special requirement, the default is the normal 1 installation method.

When operating directly in the cabinet, due to the lack of protection of the cabinet door or box, it is not allowed to operate with load for personal safety



6 Installation requirements and packaging storage

6.1 Installation

It should be installed in a place where there is no explosion hazard, no conductive dust, and no enough to corrode metals and damage insulation. Use M5 screws to fix the 4 feet of the isolation switch to the installation panel or switchgear.

6.2 Packaging and storage

The material used for product packaging: plastic bag sealing, silica gel desiccant, double corrugated paper for the box, and pearl cotton for the buffer;

Storage environment and period: The product should be stored in a warehouse where the ambient temperature is - 40°C to +75°C, the relative humidity (ambient temperature +25°C) is below 90%, and there is no acid, alkaline or other corrosive gas in the surrounding air. Storage, under the above conditions, the storage period shall not exceed 36 months from the date of manufacture.

7 Accessories list and installation

7.1 List of optional accessories

No.	Name	Type	Accessory product installation and quantity
1	Handle	In switchgear	It is installed on the switchgear door and connected to the product body through a square shaft. Shaft length optional unit (mm)
		Out switchgear	Used in the switchgear, installed on the product, direct operation
2	Auxiliary contacts		Installed on the left front of the main switch, up to 2
3	Shorting bar		Installed on the terminal board of the main switch
4	Heat sinker		Installed on the terminal board of the main switch


7.1.1 Handle model explanation

SB 1 - □ / □
1 2 3 4



CS1-A 1 - □
1 2 3

No.	Serial number description	Code description
1	Function code	SB handle / CS1 -A handle
2	Design number	1
3	Square shaft code	Square shaft length, unit mm, optional 77, 88, 120, 150, 182, 200,275, 300, 350,385,400, 504, 650
4	Handle category	1: Outside the front control switchgear; 2: Outside the side control switchgear 3: Inside the front operation switchgear; 4: Inside the side operation switchgear (CS1 -A handle is only the model outside the positive operation switchgear)

Recommended opening diagram for the switchgear door of the side operating handle outside the SB1 switchgear, the torque of the 4× M4 mounting screws is 1.5 -1.6N.m

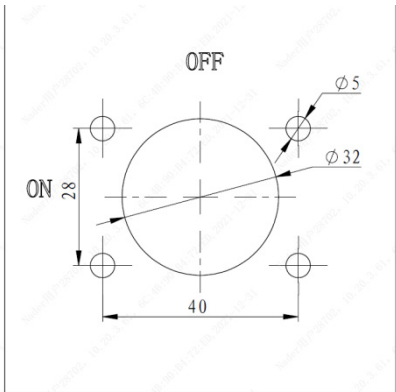

Recommended opening diagram for the switchgear door of the standard operating handle outside the SB1 switchgear, the torque of the 4 × M4 mounting screws is 1.5-1.6N.m

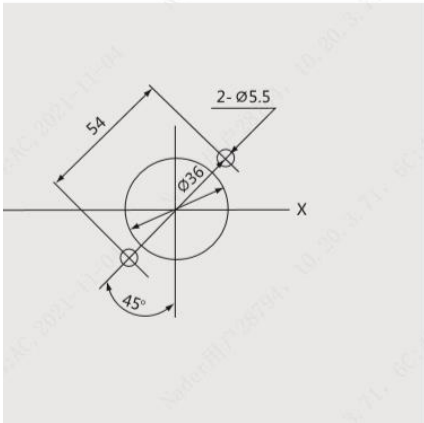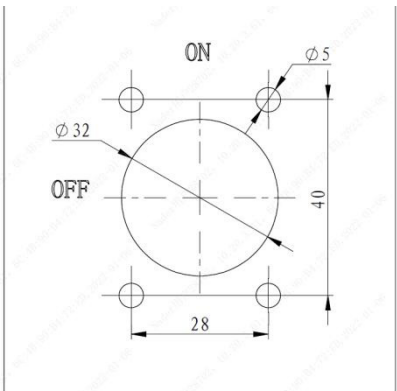

CS1 -A handle switchgear door recommended opening diagram,
2×M4 mounting screw torque 1.5 -1.6N.m ,



7.1.2 Auxiliary contact model explanation

F 1 - □ / □ / □
1 2 3 4 5

No.	Serial number description	Code description
1	Function code	Auxiliary contact
2	Design number	1
3	Contact form	01: normally closed structure 10: Normally open structure 11: Normally open-normally closed structure
4	Size	G: Auxiliary contacts according to CCC/CE/TUV standards U: Auxiliary contact according to UL standard
5	Installation Quantity	1: Install one per product 2: Install two per product

Electrical parameters in line with UL standards:

Rated working voltage	AC 125V	AC250V
Rated working current	20.5A	20.5A

Rated insulation voltage: AC1000V

Conventional heating current: Ith: 20.5A

Rated frequency: 50/60Hz

Use category: AC -15

Protection class: IP20

Electrical life: 20000 times

Minimum load: DC24V, 5mA

UL Compliant, RoHS Compliant

CCC, CE, TUV, UL

Disconnect Switch

NDG3VH-160 250 315 (G) & NDG3VH-100 200 250 275 series



Electrical parameters in line with CCC/CE/TUV standards:

Rated working voltage	AC230V	AC400V	AC690V	DC220V
Rated working current	6A	4A	2A	0.6A

- Rated insulation voltage: AC690V
- Rated impulse withstand voltage Uimp: 4kV
- Conventional heating current: Ith: 16A
- Rated frequency: 50/60Hz
- Use category: AC-15, DC -13
- Protection class: IP20
- Electrical life: 20000 times
- Minimum load: DC24V, 5mA
- Standard certification: GB/T 14048.5, RoHS compliant

8 Precautions

- 1) The quality problems caused by the unauthorized disassembly of the product are at your own risk.
- 2) In the working power-on state, do not touch the exposed part of the non-insulating part of the isolating switch.
- 3) The connecting wire should be fastened on the power distribution switchgear frame. The switch should not bear the weight of the wires. Before tightening the wires, the plane of the busbar or cable terminals should be parallel to the plane of the switch terminals. After bolting the wires to the switch terminals, the switch should not be subjected to various mechanical stresses.
- 4) The wiring must be reliable to prevent the terminal of the isolation switch from burning due to abnormal heating of the terminal.